











Test Kit, Communication Adapter, Power Supply
 Dispositivo de prueba
 Pocket de test pour

For Use With Frame DG, FG, JG, LG, MG, NG & PG
 Para Usar Con Caja Base DG, FG, JG, LG, MG, NG & PG



Installation Instructions / Instructivo de Instalación

	⚠ Danger	⚠ Peligro	⚠ Danger
	Hazardous Voltage. Will cause death or serious injury.	Tensión peligrosa. Puede causar la muerte o lesiones graves.	Tension dangereuse. Danger de mort ou risque de blessures graves.
	Turn off and lock out all power supplying this device before working on this device. Replace all covers before power supplying this device is turned on.	Desenergice totalmente antes de instalar o darle servicio. Reemplace todas las barreras y cubiertas antes de energizar el interruptor.	Couper l'alimentation de l'appareil et barrer avant de travailler. Remplacez tous les couverts avant que l'approvisionnement de pouvoir soit alimenté.



Use only with Siemens certified Components.
 Utilizar únicamente con componentes certificados de Siemens.
 A utiliser uniquement avec les composants certifiés Siemens.

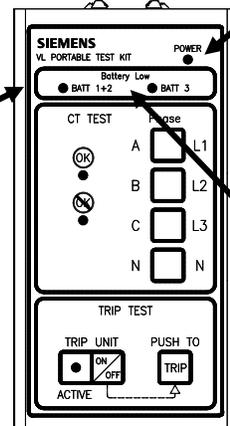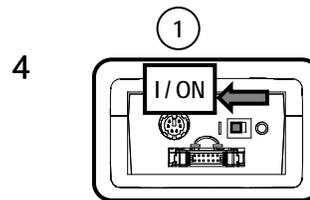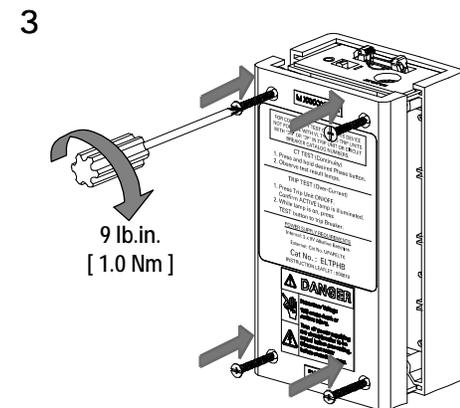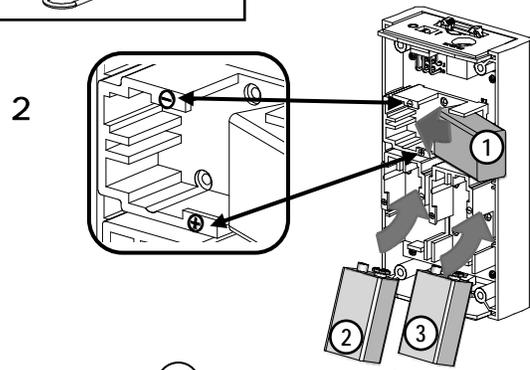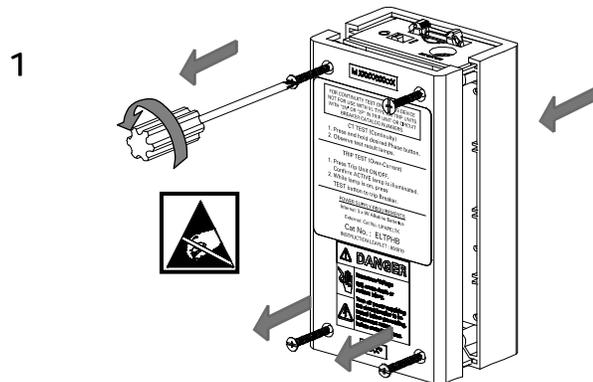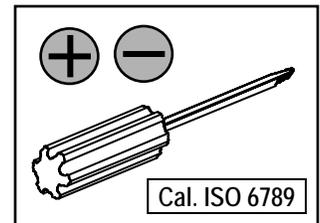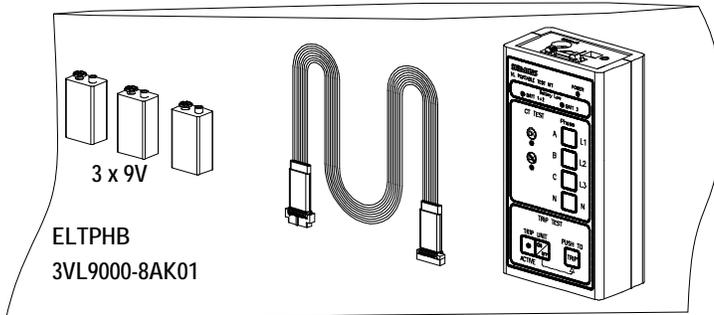

5 Option
[Opción]

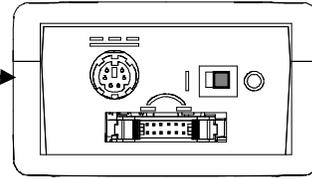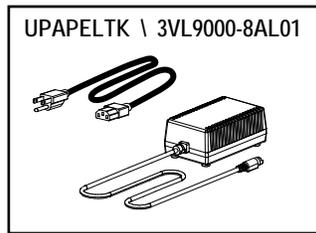


6

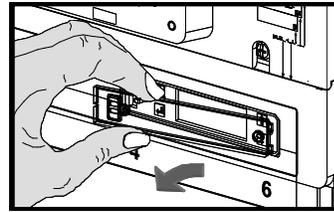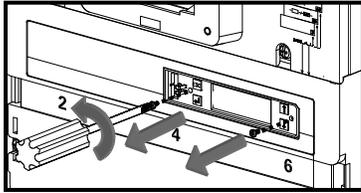








7

CT Test:
[CT Prueba:]

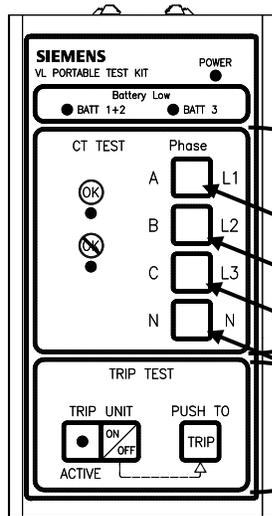

CT Test:
[CT Prueba:]

Trip Test:
[Interrupir Prueba]

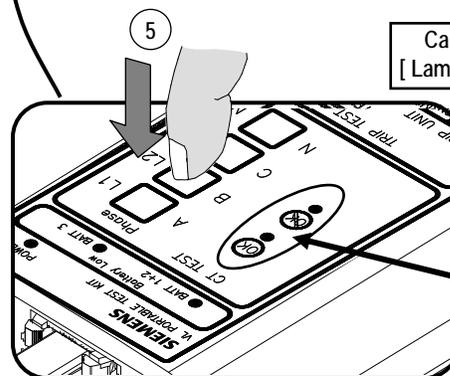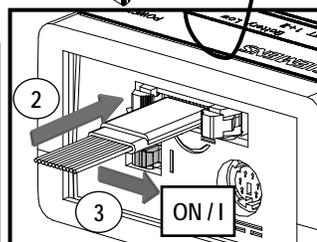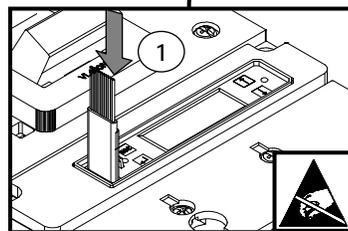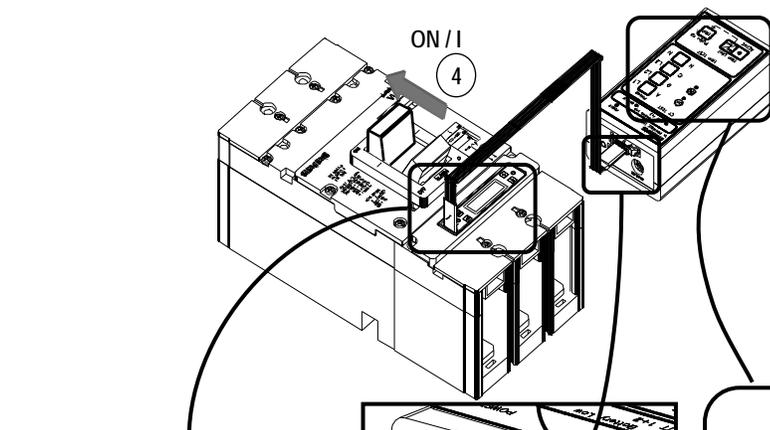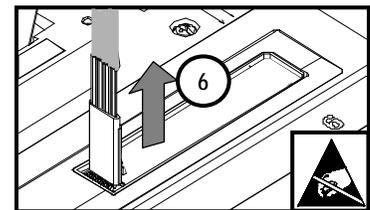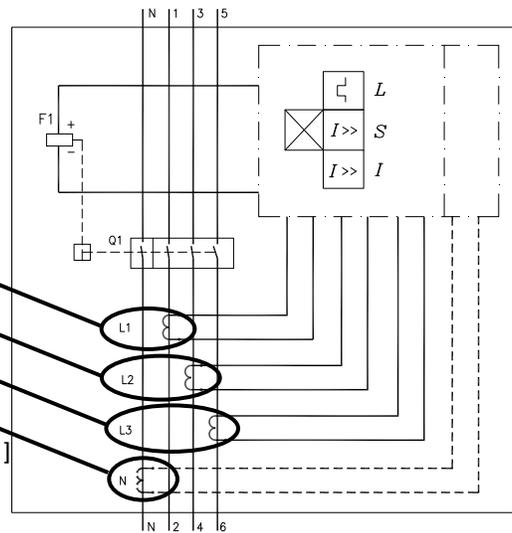


Call Technical Support
[Llamar a Soporte Técnico]




10 **Ground Fault Test:**
 [Prueba: Falla a Tierra]

Trip Unit - 545 with Ground Fault - Only
 [Disparador - 545 con Falla a Tierra] - Solamente

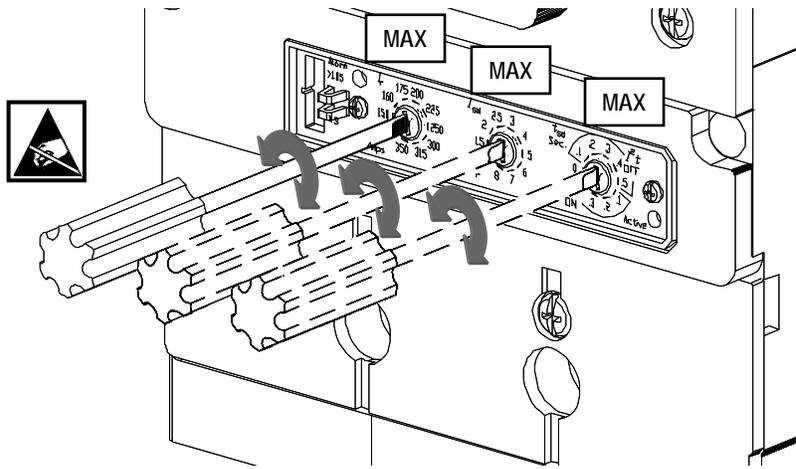

11

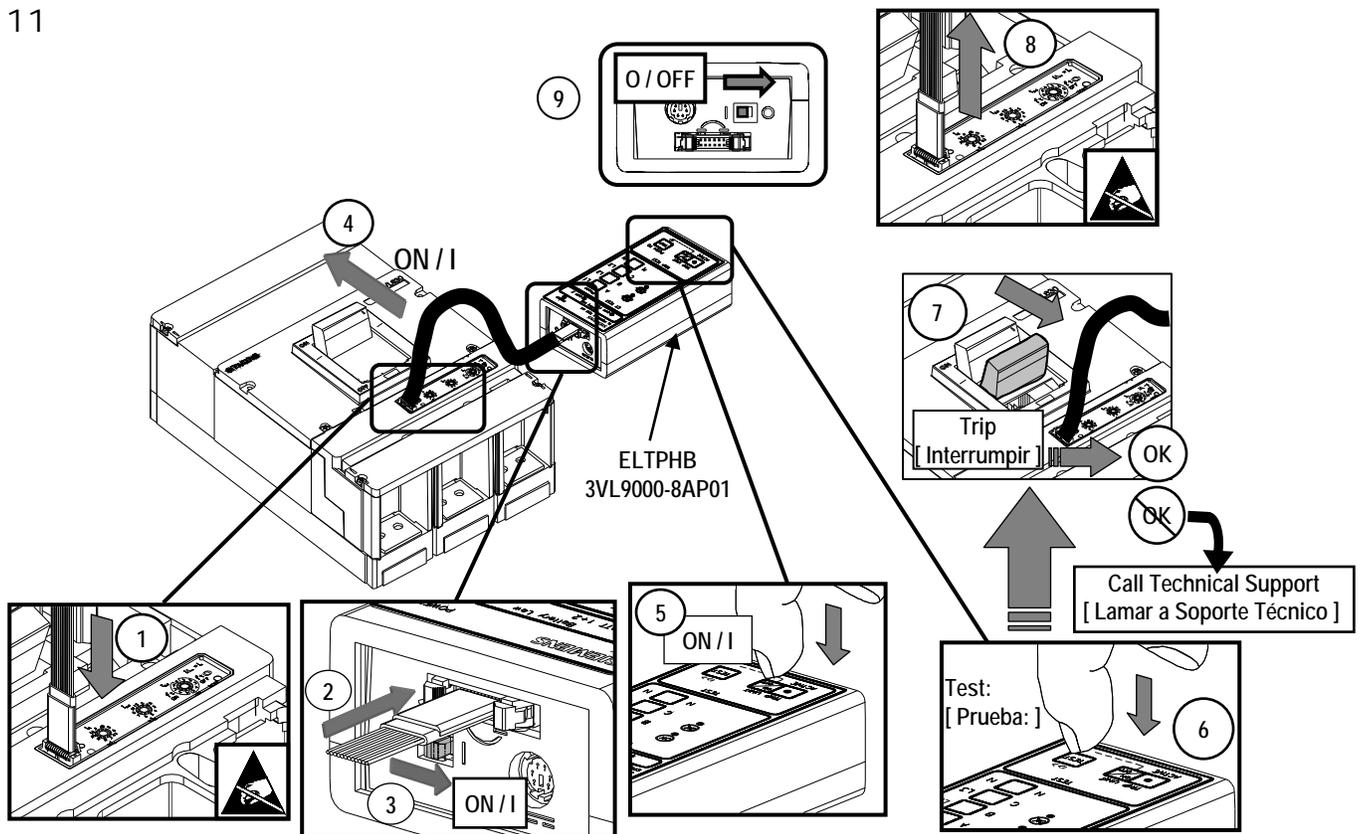

Ground Fault Test:
[Prueba: Falla a Tierra]

Trip Unit - 576 with Ground Fault - Only
[Disparador - 576 con Falla a Tierra] - Solamente

Screen [Pantalla]	Value [Valor]	Test Settings [Ajuste de prueba]
CONTINUOUS AMPS - [AMPERIOS CONT]	I_r	$I_r = 1.0 \times I_n$ Amps
LONG TIME DELAY - [RETARDO LARGO]	t_r	$t_r = 30$ s
SHORT TIME PICK UP - [TIEMPO CORTO INICIO]	I_{sd}	$I_{sd} = 6 \times I_r$ Amps
SHORT TIME DELAY - [RETARDO CORTO]	t_{sd}	$t_{sd} = 0.5$ sec.
IOC AMPS - [AMPS SOBREC INST]	I_i	$I_i = 6 \times I_n$ Amps
GROUND FAULT TYPE - [TIPO FALLA TIERR-]		= GND RESIDUAL [= RESIDUAL]

Setting Menus [Menus de Ajuste]

ELTPHB 3VL9000-8AP01

ON / I

ON / I

ON / I

Test: [Prueba:]

Trip [Interrumpir]

OK

OK

Call Technical Support [Lamar a Soporte Técnico]

Option: [Opción:]

Alarm

1.5" [38 mm] MAX.

3 lb. in. [0.3 Nm]

For Support in Europe refer to :

Bestell-Nr. / Order No.: 3ZX1012-0VL68-1AA0

Internet: www.siemens.de/lowvoltage/technical-assistance

GWA 4NEB 179 6819-10 DS03

Technical Support:

Toll Free: 1-800-964-4114

Internet: www.sea.siemens.com